

DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS


*Theresa Gabriel*  
 REGISTERED ELECTRICAL ENGINEER  
 October 30, 2015  
 PLANS APPROVAL DATE  
 Theresa Aziz Gabriel  
 No. E15129  
 EXP. 6-30-16  
 ELECTRICAL  
 STATE OF CALIFORNIA

THE STATE OF CALIFORNIA OR ITS OFFICERS OR AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF SCANNED COPIES OF THIS PLAN SHEET.

TO ACCOMPANY PLANS DATED \_\_\_\_\_


**NOTES:**

1. Type 4 conduit shall be secured to the nearest walkway bracket using one-hole galvanized malleable iron or steel straps and brass machine screws tapped into the bracket.
2. See Overhead Signs Standard Plans for overhead signs and frame juncture details for photoelectric unit installation.
3. Enclosures and straps shall be secured by  $\frac{3}{8}$ " maximum size screws.
4. The Contactor and test switch enclosures shall be readily accessible from the sign walkway.

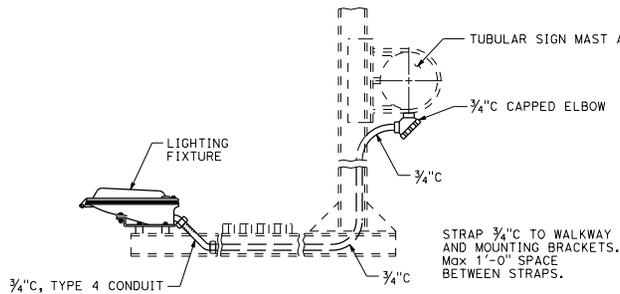


**TYPICAL SIGN ILLUMINATION EQUIPMENT  
INSTALLATION FOR OVERHEAD SIGNS TUBULAR**

DETAIL A

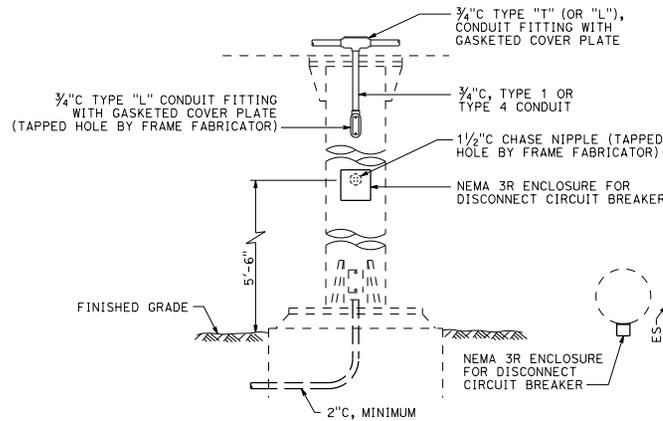


**TYPICAL SIGN ILLUMINATION EQUIPMENT  
INSTALLATION FOR OVERHEAD SIGNS ROUND POST**


DETAIL B

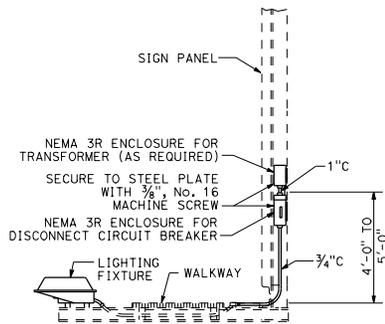

SIDE VIEW

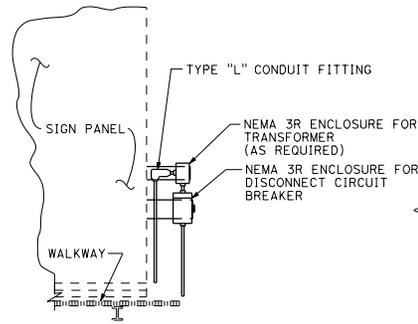

FRONT VIEW

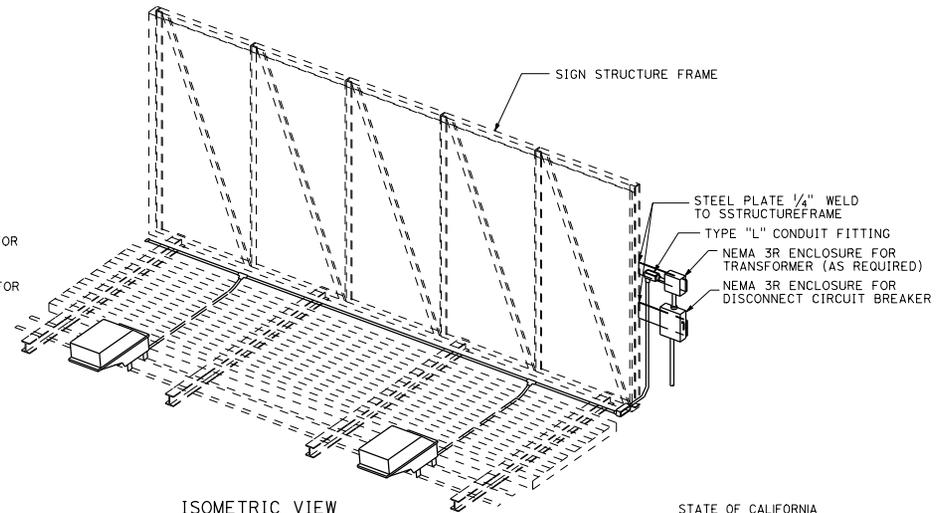

ISOMETRIC VIEW

**TYPICAL SIGN ILLUMINATION EQUIPMENT  
INSTALLATION FOR OVERHEAD SIGNS  
BRIDGE MOUNTED**

DETAIL C

See Note 4

STATE OF CALIFORNIA  
DEPARTMENT OF TRANSPORTATION  
**ELECTRICAL SYSTEMS  
(SIGN ILLUMINATION EQUIPMENT)**

NO SCALE

RSP ES-15C DATED OCTOBER 30, 2015 SUPERSEDES STANDARD PLAN ES-15C DATED MAY 20, 2011 - PAGE 498 OF THE STANDARD PLANS BOOK DATED 2010.

**REVISED STANDARD PLAN RSP ES-15C**

2010 REVISED STANDARD PLAN RSP ES-15C